EXHIBIT G2

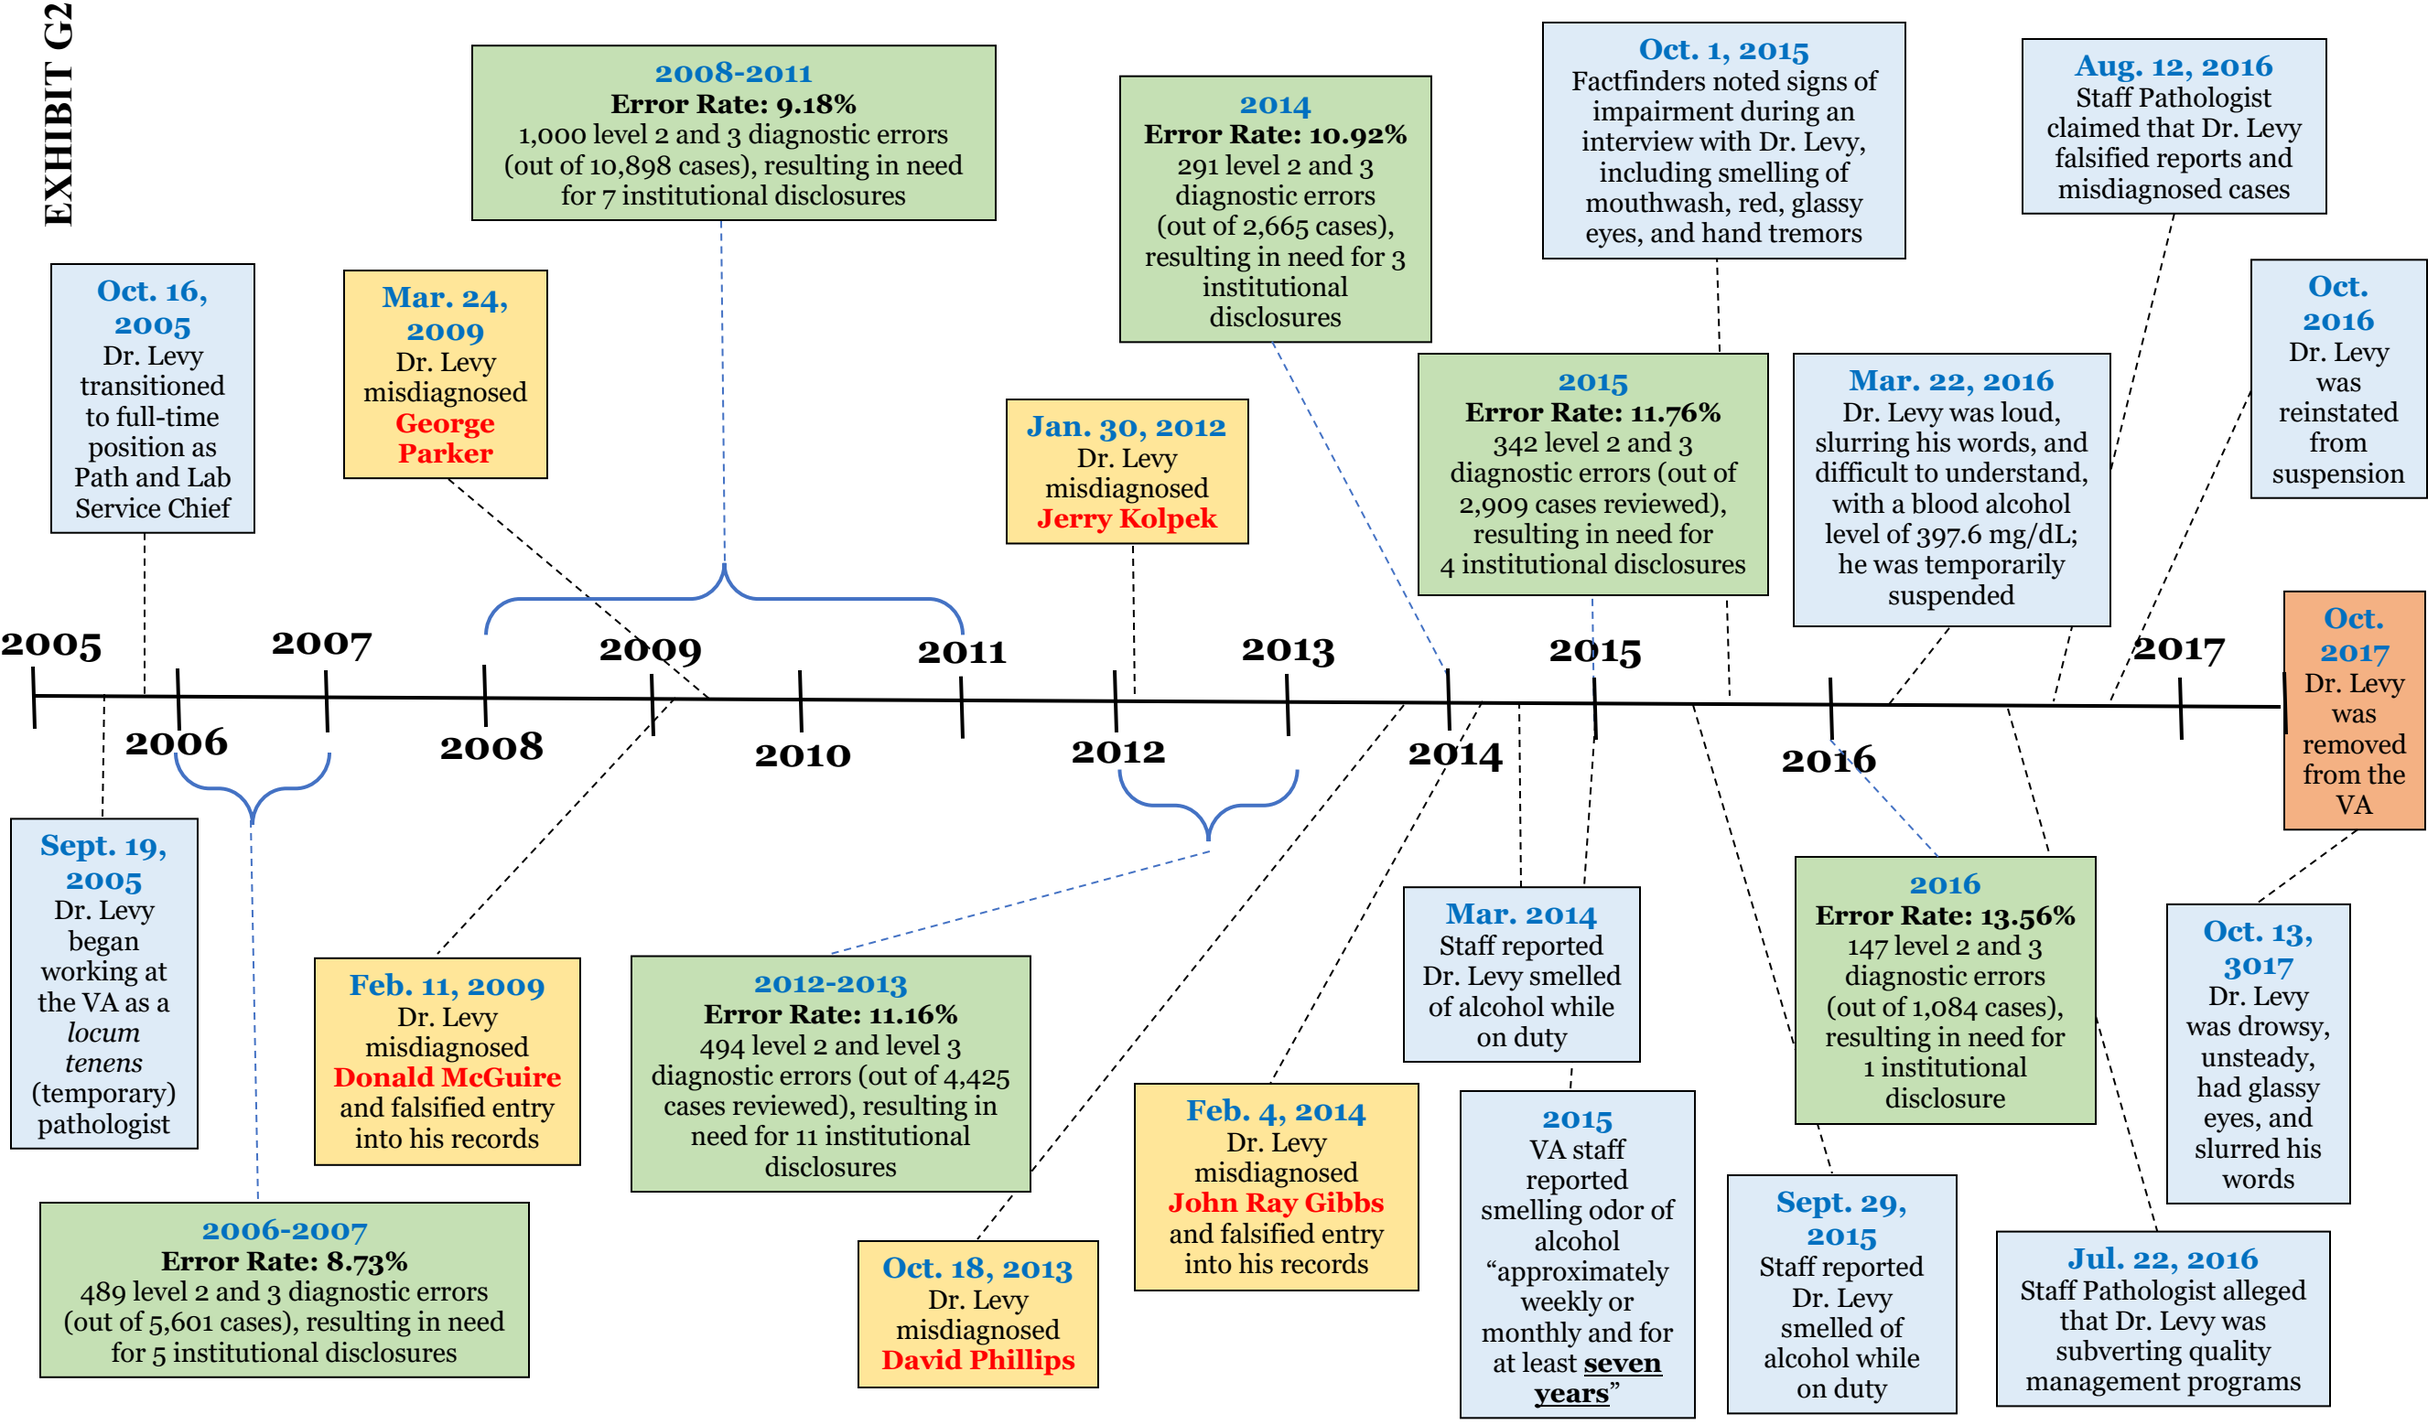
2005
2006
2007
2008
2009
2010
2011
2012
2013
2014
2015
2016
2017
Oct. 16, 2005
Dr. Levy transitioned to full-time position as Path and Lab Service Chief
Sept. 19, 2005
Dr. Levy began working at the VA as a *locum tenens* (temporary) pathologist
2006-2007
Error Rate: 8.73%
489 level 2 and 3 diagnostic errors (out of 5,601 cases), resulting in need for 5 institutional disclosures
Mar. 24, 2009
Dr. Levy misdiagnosed George Parker
Feb. 11, 2009
Dr. Levy misdiagnosed Donald McGuire and falsified entry into his records
2008-2011
Error Rate: 9.18%
1,000 level 2 and 3 diagnostic errors (out of 10,898 cases), resulting in need for 7 institutional disclosures
2012-2013
Error Rate: 11.16%
494 level 2 and level 3 diagnostic errors (out of 4,425 cases reviewed), resulting in need for 11 institutional disclosures
Jan. 30, 2012
Dr. Levy misdiagnosed Jerry Kolpek
Oct. 18, 2013
Dr. Levy misdiagnosed David Phillips
2014
Error Rate: 10.92%
291 level 2 and 3 diagnostic errors (out of 2,665 cases), resulting in need for 3 institutional disclosures
Feb. 4, 2014
Dr. Levy misdiagnosed John Ray Gibbs and falsified entry into his records
Mar. 2014
Staff reported Dr. Levy smelled of alcohol while on duty
2015
VA staff reported smelling odor of alcohol "approximately weekly or monthly and for at least seven years"
2015
Error Rate: 11.76%
342 level 2 and 3 diagnostic errors (out of 2,909 cases reviewed), resulting in need for 4 institutional disclosures
Oct. 1, 2015
Factfinders noted signs of impairment during an interview with Dr. Levy, including smelling of mouthwash, red, glassy eyes, and hand tremors
Sept. 29, 2015
Staff reported Dr. Levy smelled of alcohol while on duty
2016
Error Rate: 13.56%
147 level 2 and 3 diagnostic errors (out of 1,084 cases), resulting in need for 1 institutional disclosure
Mar. 22, 2016
Dr. Levy was loud, slurring his words, and difficult to understand, with a blood alcohol level of 397.6 mg/dL; he was temporarily suspended
Aug. 12, 2016
Staff Pathologist claimed that Dr. Levy falsified reports and misdiagnosed cases
Jul. 22, 2016
Staff Pathologist alleged that Dr. Levy was subverting quality management programs
Oct. 2016
Dr. Levy was reinstated from suspension
Oct. 13, 3017
Dr. Levy was drowsy, unsteady, had glassy eyes, and slurred his words
Oct. 2017
Dr. Levy was removed from the VA